


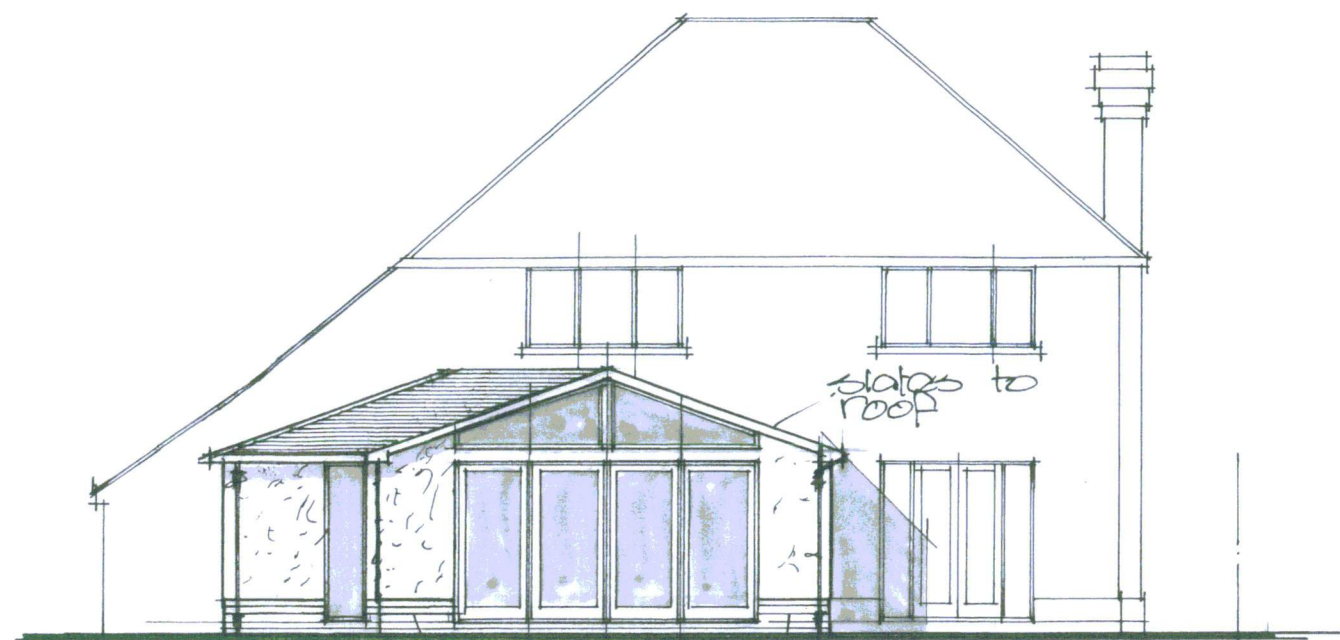


rear

facing bricks to match extq.

cut in stopped cavity tray and turn stopped lead flashing at intersection of new roof and extq. wall.

roof of slates on 38x25 battens on hyvac felt on 150 x 50 rafters @ 400 ctrs. 12.5 calotex until with further 50 calotex across face of rafters. vapour barrier. 100 of 1/2 rd 12.5 plaster gutter board & skim.

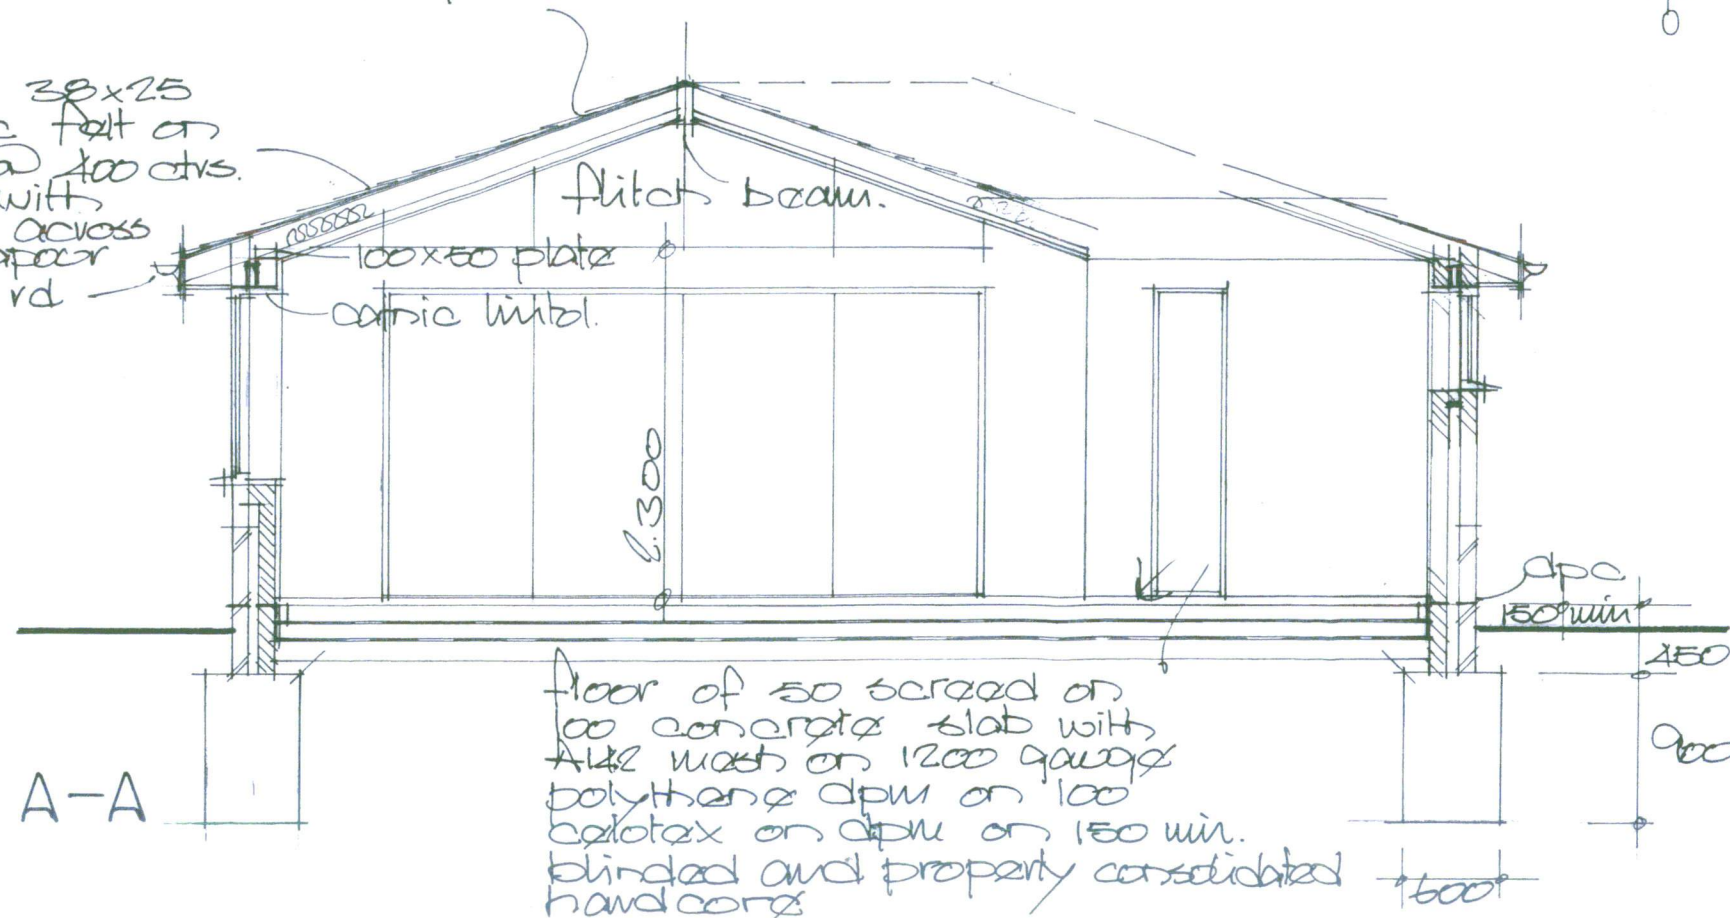

section A-A

floor of 50 screed on 100 concrete slab with A12 mesh on 1200 gauge polythene dpm on 100 calotex on dpm on 150 min. blinded and properly consolidated hand core



side

render and paint to match extq.

side

ELEVATIONS 1:100



Approved For Plot
19 OCT 2020

proposed extension to:-
17, SEATON AVE.,
HYTHE

DS/2225/3