



Planning Validation Team
Folkestone & Hythe District Council
Civic Centre
Castle Hill Avenue
Folkestone
Kent
CT20 2QY

Your ref
24/0417/FH

Our ref
DSA000033481

Date
06 May 2024

Contact
Tel 0330 303 0119

Dear Sir/Madam,

Proposal: Outline planning application (all matters reserved) for self-build development of five detached houses, together with vehicular access, parking and landscaping.

Site: 24/0417/FH: - Former Piggery, Horn Street, Hythe, CT21 5SN.

Thank you for your letter dated 15 April 2024.

Following the review of the submitted documents, we have the below comments for the Planning consultation.

Protection of Public Apparatus

Please see the attached extract from Southern Water records showing the approximate position of our existing public combined sewer within the access of the development site. The exact position of the public asset must be determined on site by the applicant in consultation with Southern Water before the layout of the proposed development is finalised.

- The 160 mm diameter gravity sewer requires a clearance of 3 metres on either side of the gravity sewer to protect it from construction works and to allow for future maintenance access.
- No development or tree planting should be carried out within 3 metres of the external edge of the public gravity sewer without consent from Southern Water.
- No soakaways, swales, ponds, watercourses or any other surface water retaining or conveying features should be located within 5 metres of public or adoptable gravity sewers.
- All existing infrastructure should be protected during the course of construction works.

Please refer to: southernwater.co.uk/media/st5orjvm/stand-off-distances.pdf



It is possible that a sewer now deemed to be public could be crossing the development site. Therefore, should any sewer be found during construction works, an investigation of the sewer will be required to ascertain its ownership before any further works commence on site.

Foul and Surface Water Drainage

Southern Water requires a formal application for a connection to the public foul sewer to be made by the applicant or developer.

To make an application visit Southern Water's Get Connected service: developerservices.southernwater.co.uk and please read our New Connections Charging Arrangements documents which are available on our website via the following link: southernwater.co.uk/developing-building/connection-charging-arrangements

The supporting documents make reference to drainage using Sustainable Drainage Systems (SuDS).

Under certain circumstances SuDS will be adopted by Southern Water should this be requested by the developer. Where SuDS form part of a continuous sewer system, and are not an isolated end of pipe SuDS component, adoption will be considered if such systems comply with the latest Design and Construction Guidance (Appendix C) and CIRIA guidance available here:

water.org.uk/sewerage-sector-guidance-approved-documents/

ciria.org/ItemDetail?iProductCode=C753F&Category=FREEPUBS

Where SuDS rely upon facilities which are not adoptable by sewerage undertakers the applicant will need to ensure that arrangements exist for the long-term maintenance of the SuDS facilities. It is critical that the effectiveness of these systems is maintained in perpetuity. Good management will avoid flooding from the proposed surface water system, which may result in the inundation of the foul sewerage system.

Thus, where a SuDS scheme is to be implemented, the drainage details submitted to the Local Planning Authority should:

- Specify the responsibilities of each party for the implementation of the SuDS scheme.
- Specify a timetable for implementation.
- Provide a management and maintenance plan for the lifetime of the development.

This should include the arrangements for adoption by any public authority or statutory undertaker and any other arrangements to secure the operation of the scheme throughout its lifetime.

The Council's Building Control officers or technical staff should be asked to comment on the adequacy of soakaways to dispose of surface water from the proposed development.




For further advice, please contact Southern Water, Southern House, Yeoman Road, Worthing, West Sussex, BN13 3NX (Tel: 0330 303 0119).

Website: southernwater.co.uk or by email at: SouthernWaterPlanning@southernwater.co.uk

Yours faithfully,

Future Growth Planning Team
Developer Services

southernwater.co.uk/developing-building/planning-your-development

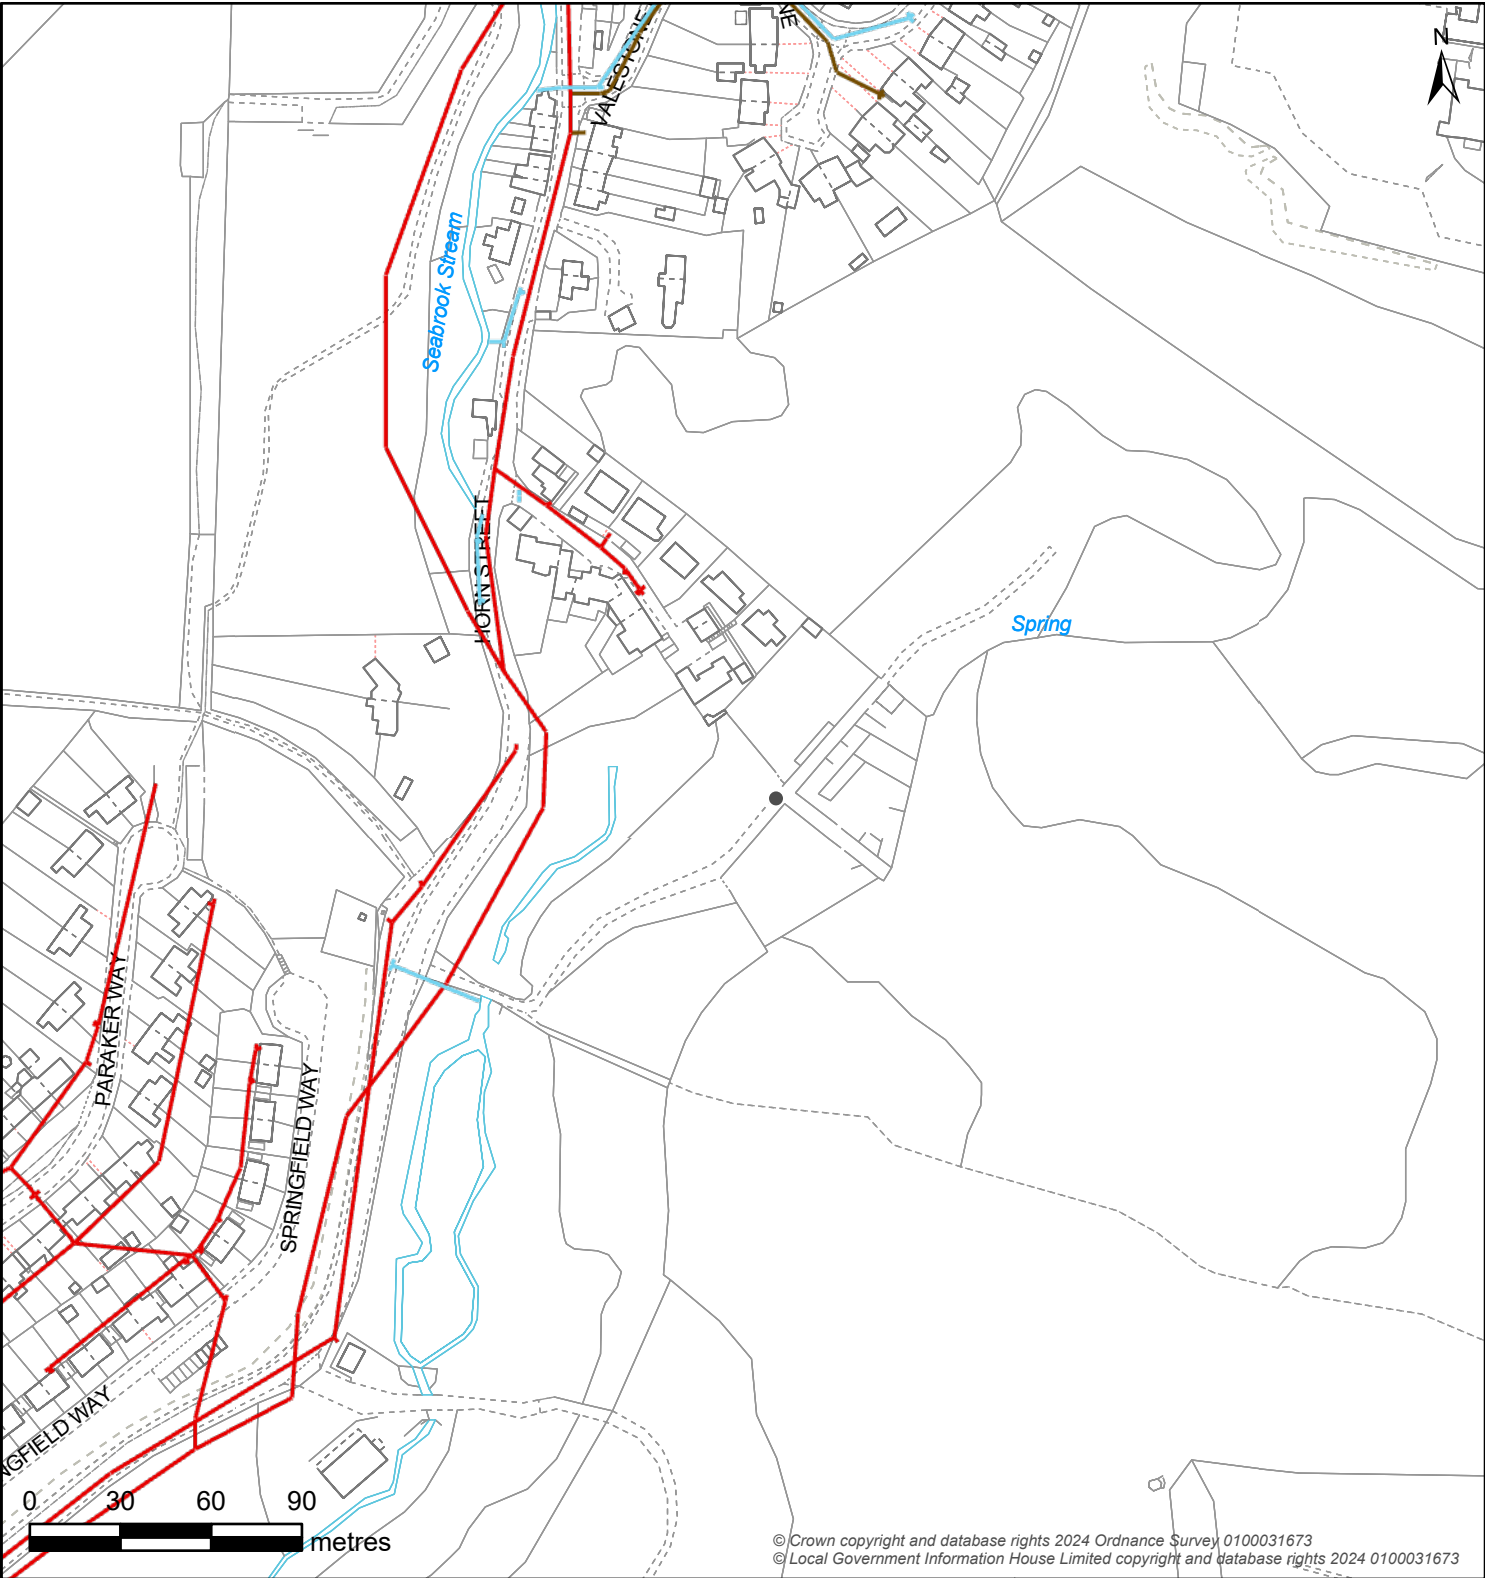

© Crown copyright and database rights 2024 Ordnance Survey 0100031673
© Local Government Information House Limited copyright and database rights 2024 0100031673

Map Title: SW Print

Printed By: Sanjay.Boregowda
Date Printed: 02/05/2024
Map Scale: 2500

The information provided is believed to be correct but is provided on an 'as is' basis and without any warranty or condition express or implied, statutory or otherwise as to its quality or fitness for purpose. Actual positions of assets should always be determined on site.



Controllable Valve			Flow Control			Inlet-Outfall	
Damboards	Penstock	Valve	Anti Flood Device	Pumped Anti Flood Device	Reflux Valve	Inlet	Outfall
Manhole							
BIF Bifurcation	Cascade	CP Catchpit	Head Of Public Sewer	IC Interceptor Chamber	Manhole	S Soakaway	WO Washout
Outfall Headworks		Overflow Chamber		Pipe Bridge		Pumping Station	
Outfall Headworks	CSO Combined Sewer Overflow	EMO Emergency Overflow	Pipe Bridge	Micro Pumping Station	Pumping Station		
Sewer Level Monitor		Storage		Treatment Works		Weir	
Sewer Level Monitor	Storm Tank	Tidal Storage Tank	Treatment Works	Weir	Wastewater Site		
Wastewater Pipe				Wastewater Use		Developer Services	
Culverted Water Course	Syphon	Tank Sewer	Trunk Sewer	Foul	Combined	Build Over Agreement	Section 104
Drain	Vacuum Main	Decommissioned Pipe		Sludge	Treated Effluent	Wastewater Area	
Outfall				Surface Water	Private	Catchment	Sub-Catchment
Overflow							
Rising Main							
Sewer							